
## CITY OF WINTER PARK

## **WATER & WASTEWATER UTILITY DEPARTMENT**

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

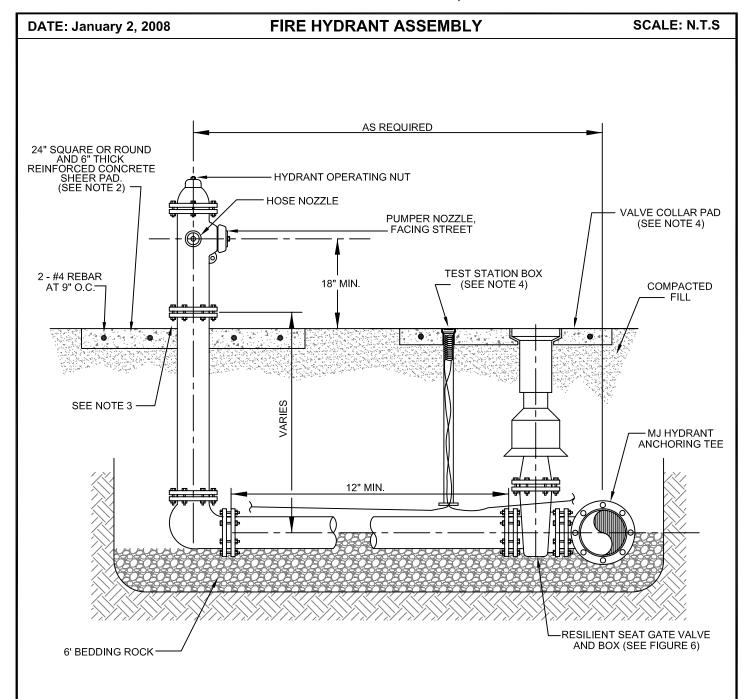

## NOTES:

- 1. FIRE HYDRANT SHALL BE SUPPLIED WITHOUT A WEEP HOLE, OR WITH A PERMANENTLY PLUGGED WEEP HOLE.
- 2. CLEARANCE BETWEEN BOTTOM OF BOLTS AND TOP OF SHEAR PAD SHALL BE 6" MINIMUM.
- 3. CLOW, KENNEDY OR MUELLER HYDRANTS, ONLY.
- 4. SEE FIGURE 10 AND 42 FOR DETAILED SPECIFICATIONS.