

CITY OF WINTER PARK


WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

BLOW OFF VALVE-STANDARD

SCALE: N.T.S

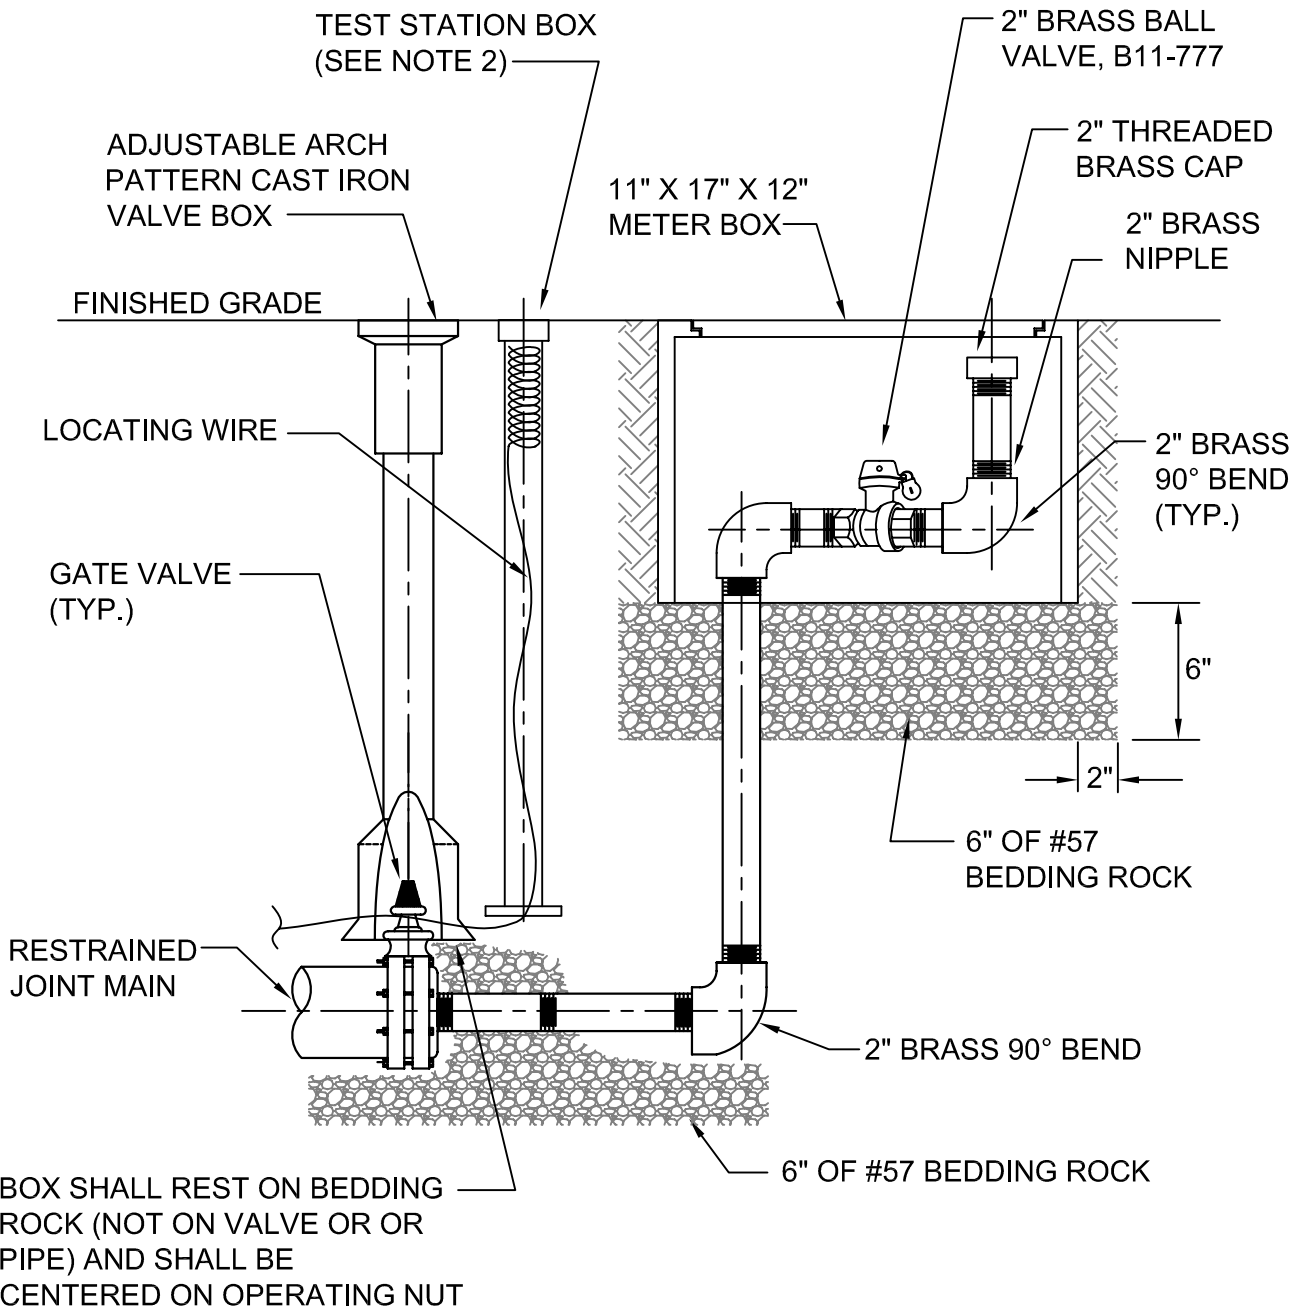

NOTES:

1. ALL 2" PIPE FITTINGS SHALL BE THREADED (NPT) BRASS JOINTS.
2. SEE FIGURE 42 FOR DETAILED SPECIFICATIONS.

FIGURE 19