

CITY OF WINTER PARK


WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

4" FORCE MAIN FLUSH POINT

SCALE: N.T.S

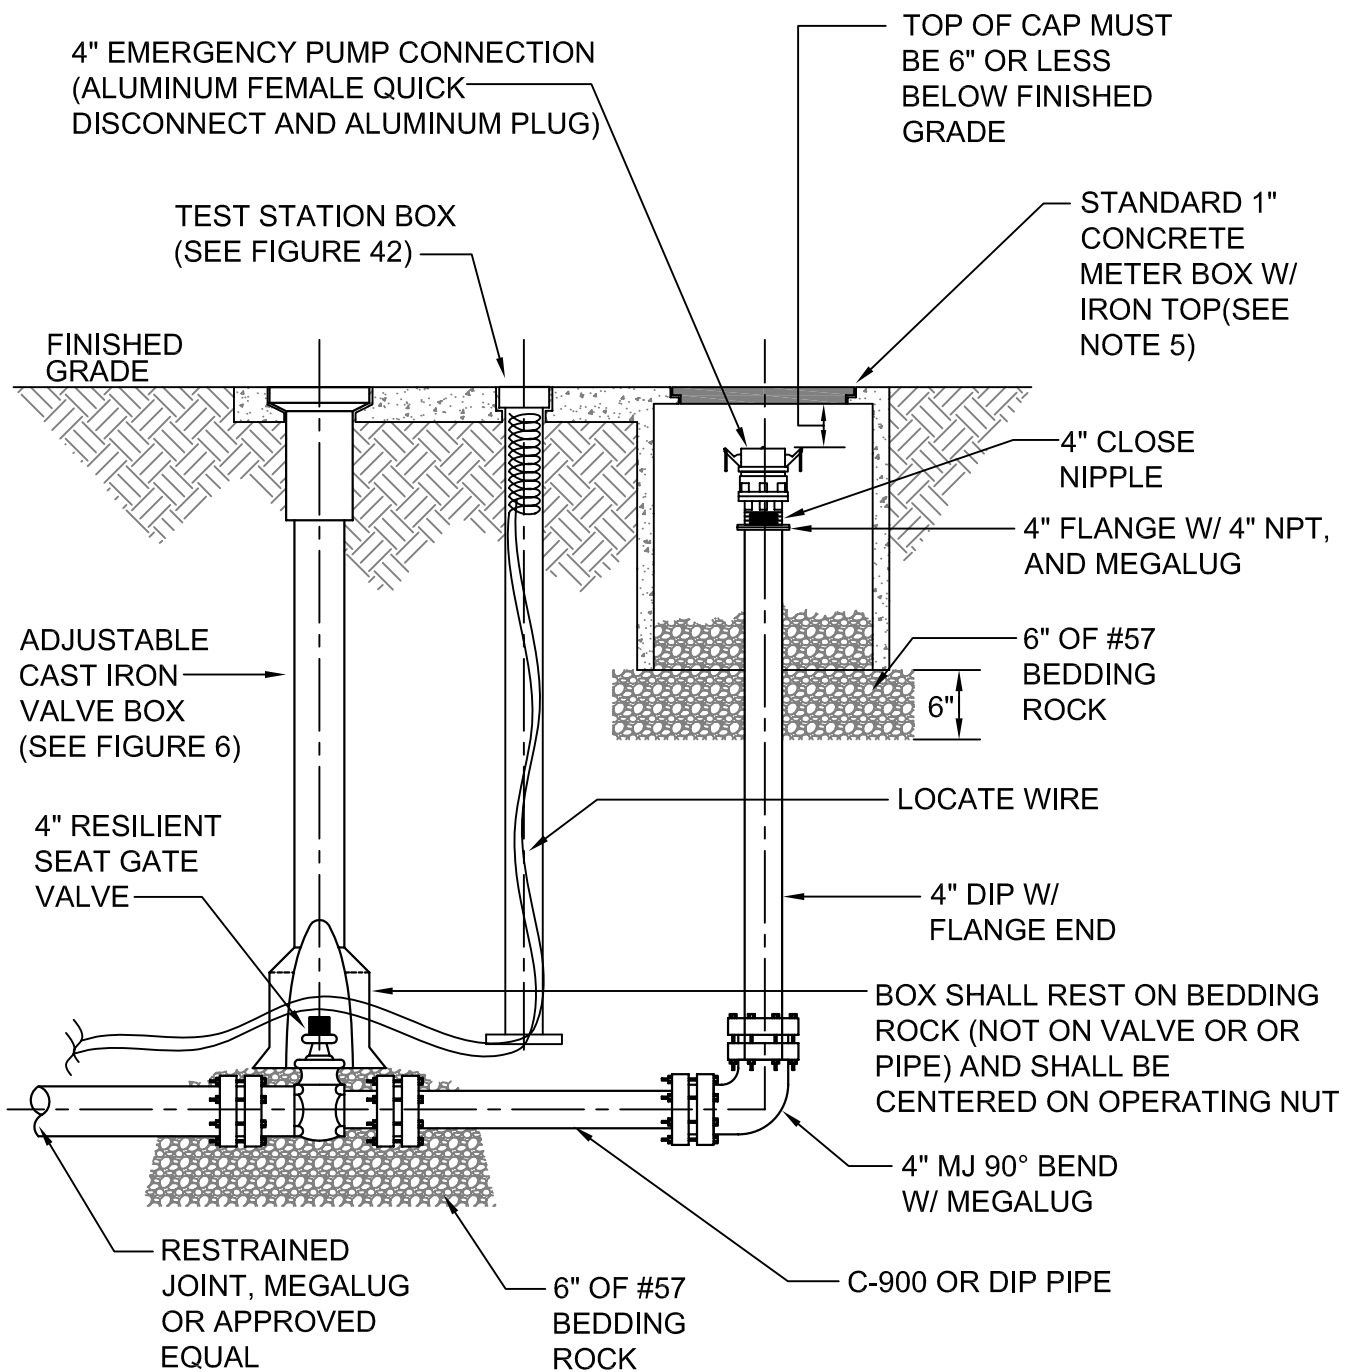

NOTES:

1. ALL 2" PIPE FITTINGS SHALL BE THREADED (NPT) BRASS JOINTS.
2. RESTRAINTS PER CITY REQUIREMENTS.
3. ALL FLANGED PIPE WILL BE WELDED FLANGE, NO FLANGE ADAPTERS.
4. REFER TO FIGURE 10 FOR PAD SPECIFICATIONS.
5. H-20 LOADING, TRAFFIC RATED LID REQUIRED IN IMPROVED CONDITIONS.

FIGURE 21