

CITY OF WINTER PARK

WATER & WASTEWATER UTILITY DEPARTMENT


REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

TEMORARY MINOR ROADWAY OPENCUT PATCH

SCALE: N.T.S

A MINOR PATCH IS AN AREA 2' X 4' OR LESS

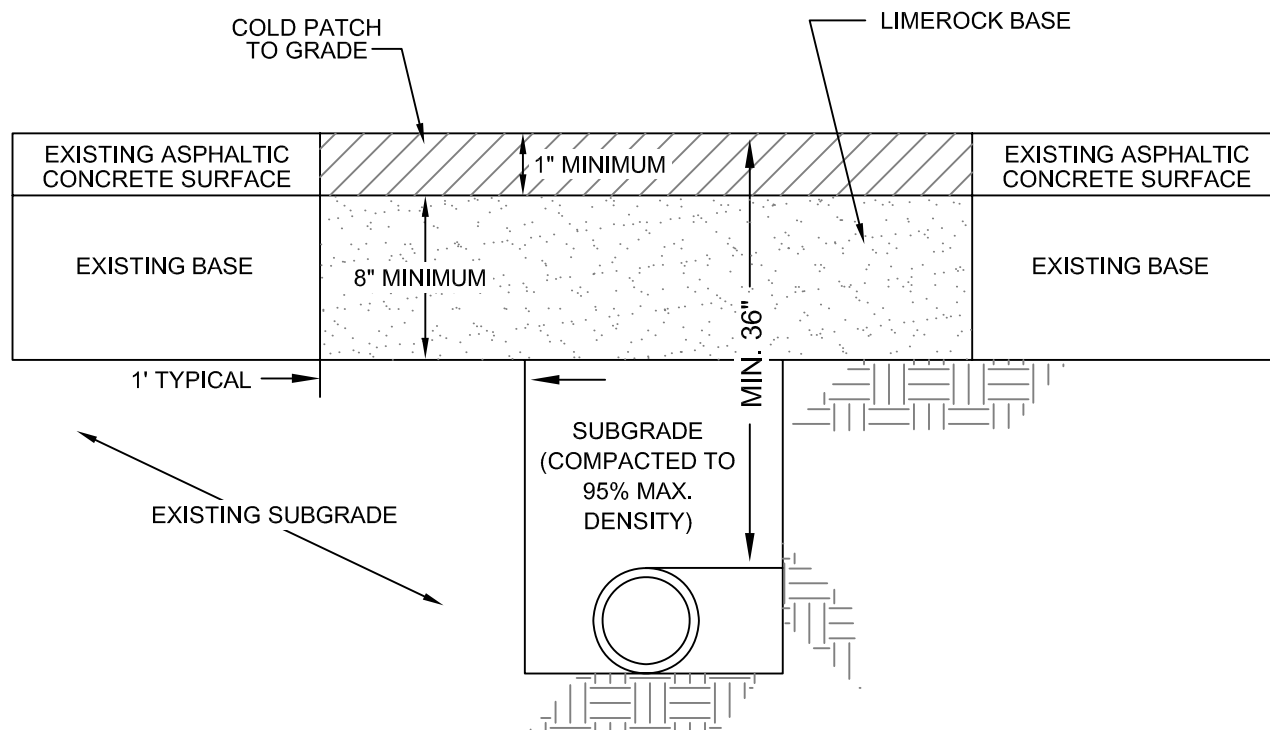

LEGEND



COLD PATCH



8" MINIMUM LIMEROCK
OR MATCH EXISTING,
WHICHEVER IS GREATER.

NOTES:

1. SUBGRADE TO BE COMPACTED TO 95% MAXIMUM DENSITY AS DETERMINED BY AASHTO T-180.
2. BASE REPLACEMENT SHALL BE LIMEROCK COMPACTED TO 95%, AASHTO T-100.
4. TEMPORARY COLD PATCH TO BE APPLIED TO FINISHED GRADE.
5. MINIMUM COLD PATCH SURFACE THICKNESS SHALL BE 1" OR AS APPROVED BY THE THE COUNTY OR CITY ENGINEER.
6. ALL JOINT CUTS SHALL BE MECHANICALLY SAW CUT.
7. ADDITIONAL REQUIREMENTS MAY BE STATED ON THE APPROVED PERMIT.
8. DENSITY RESULTS SHALL BE PROVIDED TO THE CITY, COUNTY OR FDOT AS REQUIRED.
9. 1' SETBACK OF BASE REMOVAL IS PERFORMED AFTER THE TRENCH IS BACKFILLED AND COMPACTED TO SUBGRADE.