
CITY OF WINTER PARK

WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

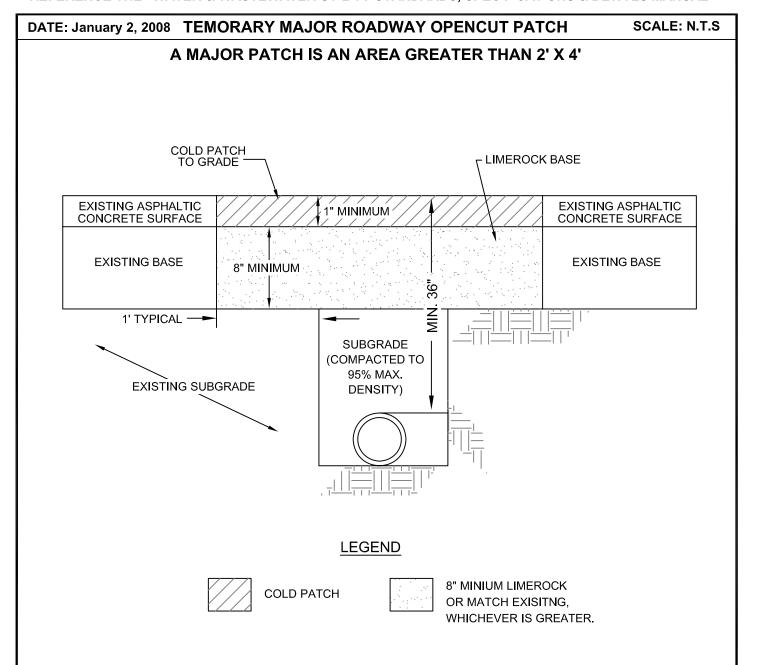

NOTES:

- SUBGRADE TO BE COMPACTED TO 95% MAXIMUM DENSITY AS DETERMINED BY AASHTO T-180.
- 2. BASE REPLACEMENT SHALL BE LIMEROCK COMPACTED TO 95%, AASHOT-180.
- 4. TEMPORARY COLD PATCH TO BE APPLIED TO FINISHED GRADE.
- 5. MINIMUM COLD PATCH SURFACE THICKNESS SHALL BE 1" OR AS APPROVED BY THE THE COUNTY OR CITY ENGINEER.
- 6. ALL JOINT CUTS SHALL BE MECHANICALLY SAW CUT.
- 7. ADDITIONAL REQUIREMENTS MAY BE STATED ON THE APPROVED PERMIT.
- 8. DENSITY RESULTS SHALL BE PROVIDED TO THE CITY, COUNTY OR FDOT AS REQUIRED.
- 9. 1' SETBACK OF BASE REMOVAL IS PERFORMED AFTER THE TRENCH IS BACKFILLED AND COMPACTED TO SUBGRADE.