

CITY OF WINTER PARK

WATER & WASTEWATER UTILITY DEPARTMENT


REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

RESIDENTIAL UTILITY PLAN-WATER

SCALE: N.T.S

SINGLE FAMILY

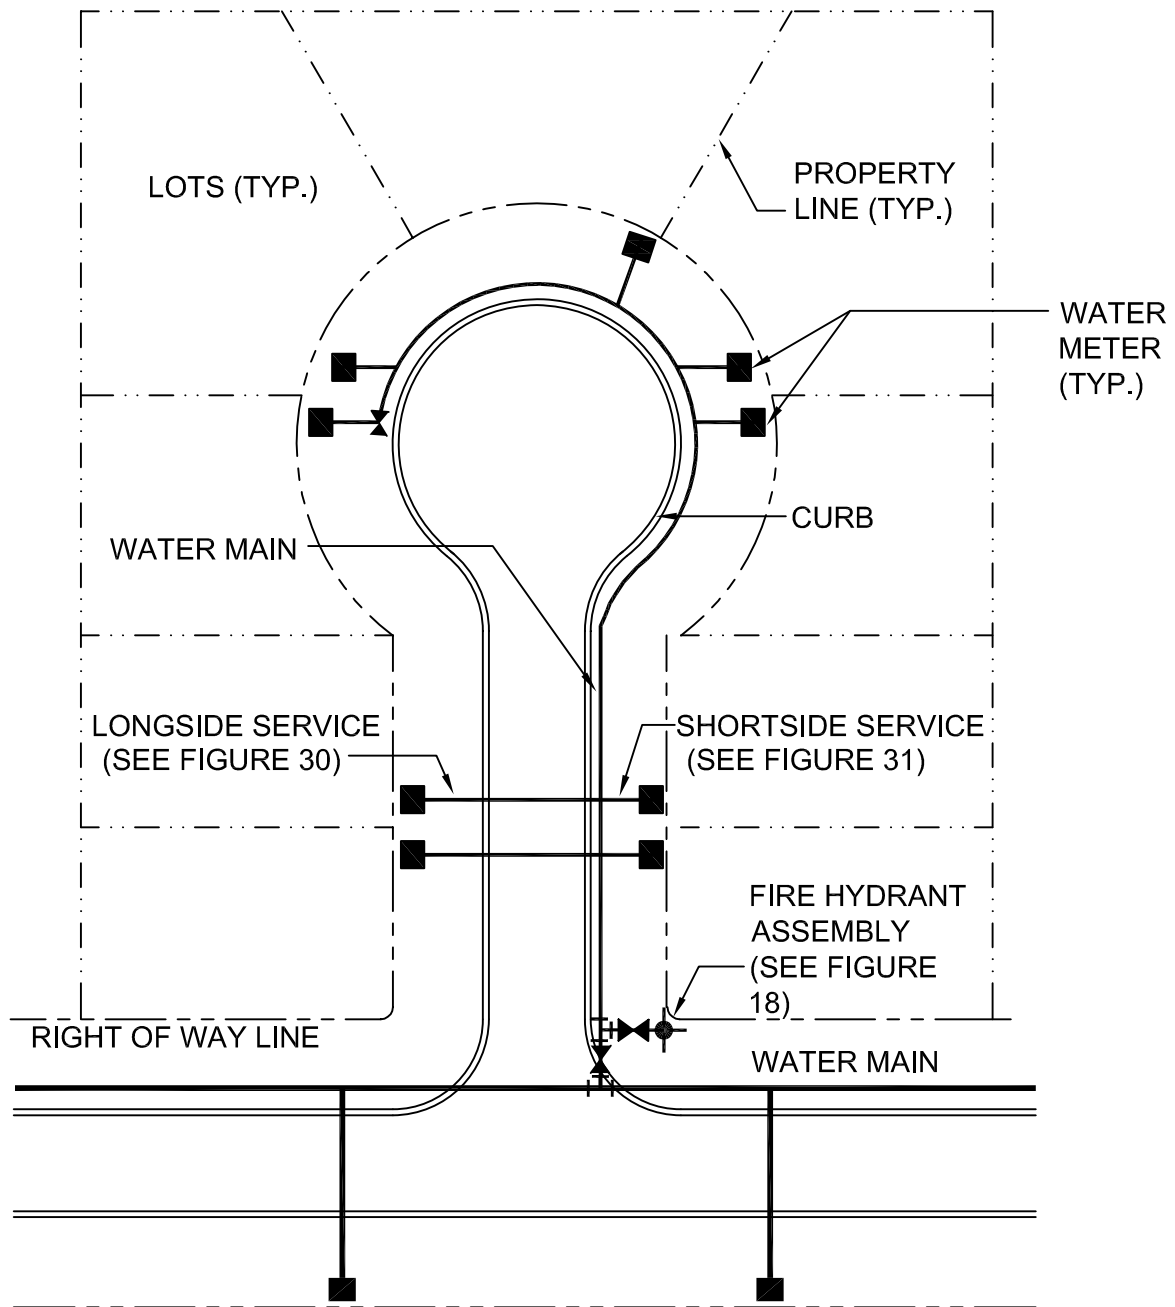

NOTES:

1. REDUCED PRESSURE ZONE (RPZ) BACKFLOW PREVENTER REQUIRED WHEN AN AUXILIARY WATER SOURCE IS PRESENT
2. EACH SERVICE SHALL TERMINATE AT A CURB STOP(S) WHICH SHALL BE BURIED APPROXIMATELY 3" BELOW FINAL GRADE AND CLEARLY MARKED WITH A 2" X 2" X 18" STAKE AND PAINTED WITH THE COLOR OF THE PROVIDED UTILITY SERVICE AND LABELED WITH LOT NUMBER IT SERVES.
3. ALL LONG SIDE SERVICES SHALL BE ENCASED AND THE CASING EXTEND A MINIMUM OF FIVE FEET BEYOND THE EDGE OF PAVEMENT.

FIGURE 24