
CITY OF WINTER PARK

WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

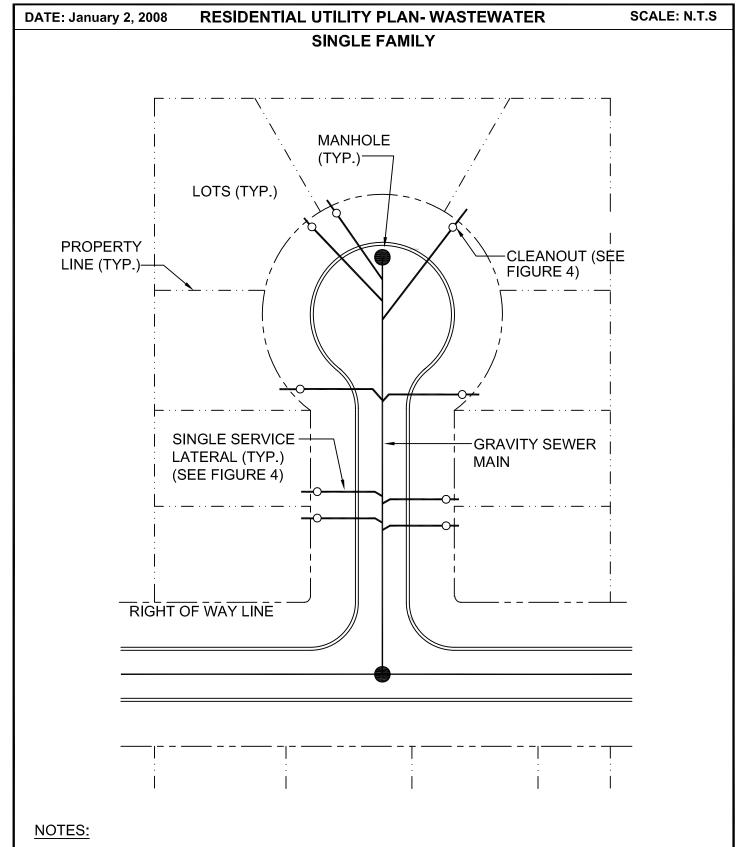

1. EACH SERVICE SHALL TERMINATE AT A CURB STOP(S) WHICH SHALL BE BURIED APPROXIMATELY 3" BELOW FINAL GRADE AND CLEARLY MARKED WITH A 2" X 2" X 18" STAKE AND PAINTED WITH THE COLOR OF THE PROVIDED UTILITY SERVICE AND LABELED WITH LOT NUMBER IT SERVES.