

CITY OF WINTER PARK


WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

2" WATER SERVICE CONNECTION

SCALE: N.T.S

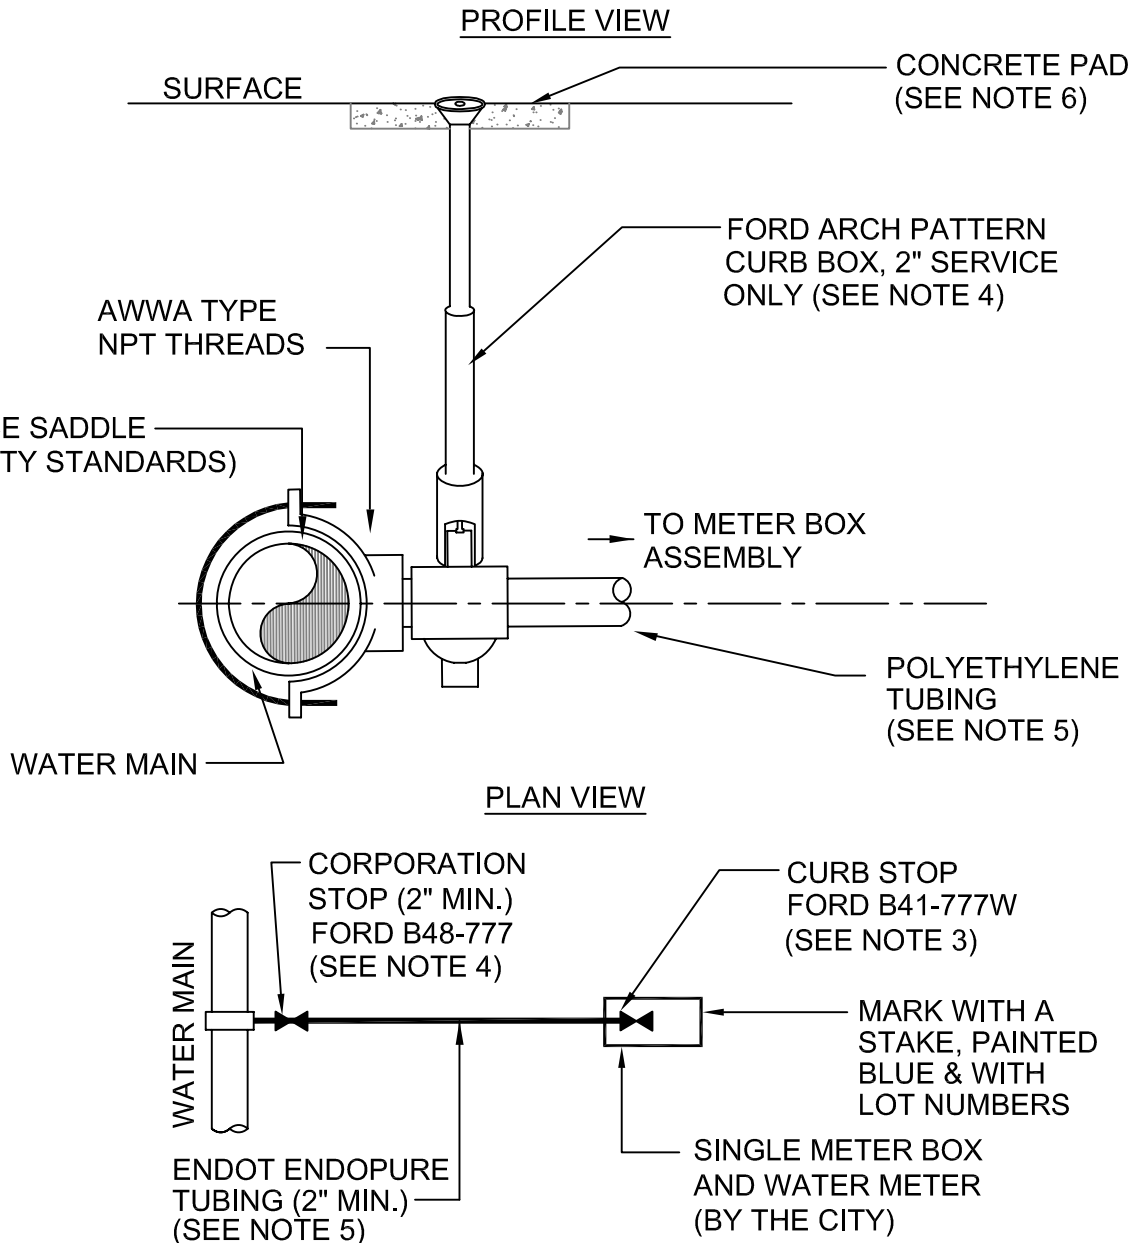

NOTES:

1. ALL FITTINGS SHALL BE BRASS WITH COMPRESSION/PACK JOINT TYPE CONNECTIONS.
2. NO SERVICE LINE SHALL TERMINATE UNDER A DRIVEWAY OR SIDEWALK.
3. EACH SERVICE SHALL TERMINATE AT A CURB STOP(S) WHICH SHALL BE BURIED APPROXIMATELY 3" BELOW FINAL GRADE AND CLEARLY MARKED WITH A 2" X 2" X 18" STAKE AND PAINTED WITH THE COLOR OF THE PROVIDED UTILITY SERVICE AND LABELED WITH LOT NUMBER IT SERVES.
4. EACH CORPORATION STOP SHALL HAVE A FORD ARCH PATTERN CURB BOX TYPE PS LID, PLUG STYLE WITH AN ARCH PATTERN BASE PER THE CITY OF WINTER PARK UTILITY DEPARTMENT STANDARDS. SEE FIGURES 1 AND 2 FOR SPECIFICATIONS.
5. POLYETHYLENE TUBING MUST BE ENDOPURE 200 PSI-PE 3408, AS MANUFACTURED BY ENDOT INDUSTRIES, ASTM D-2737.
6. DEPENDENT UPON SURFACE CONDITIONS A CONCRETE PAD MAY BE REQUIRED.

FIGURE 29