


**CITY OF WINTER PARK**  
**WATER & WASTEWATER UTILITY DEPARTMENT**  
**REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"**

DATE: January 2, 2008

**SHORTSIDE WATER SERVICE CONNECTION**

SCALE: N.T.S.

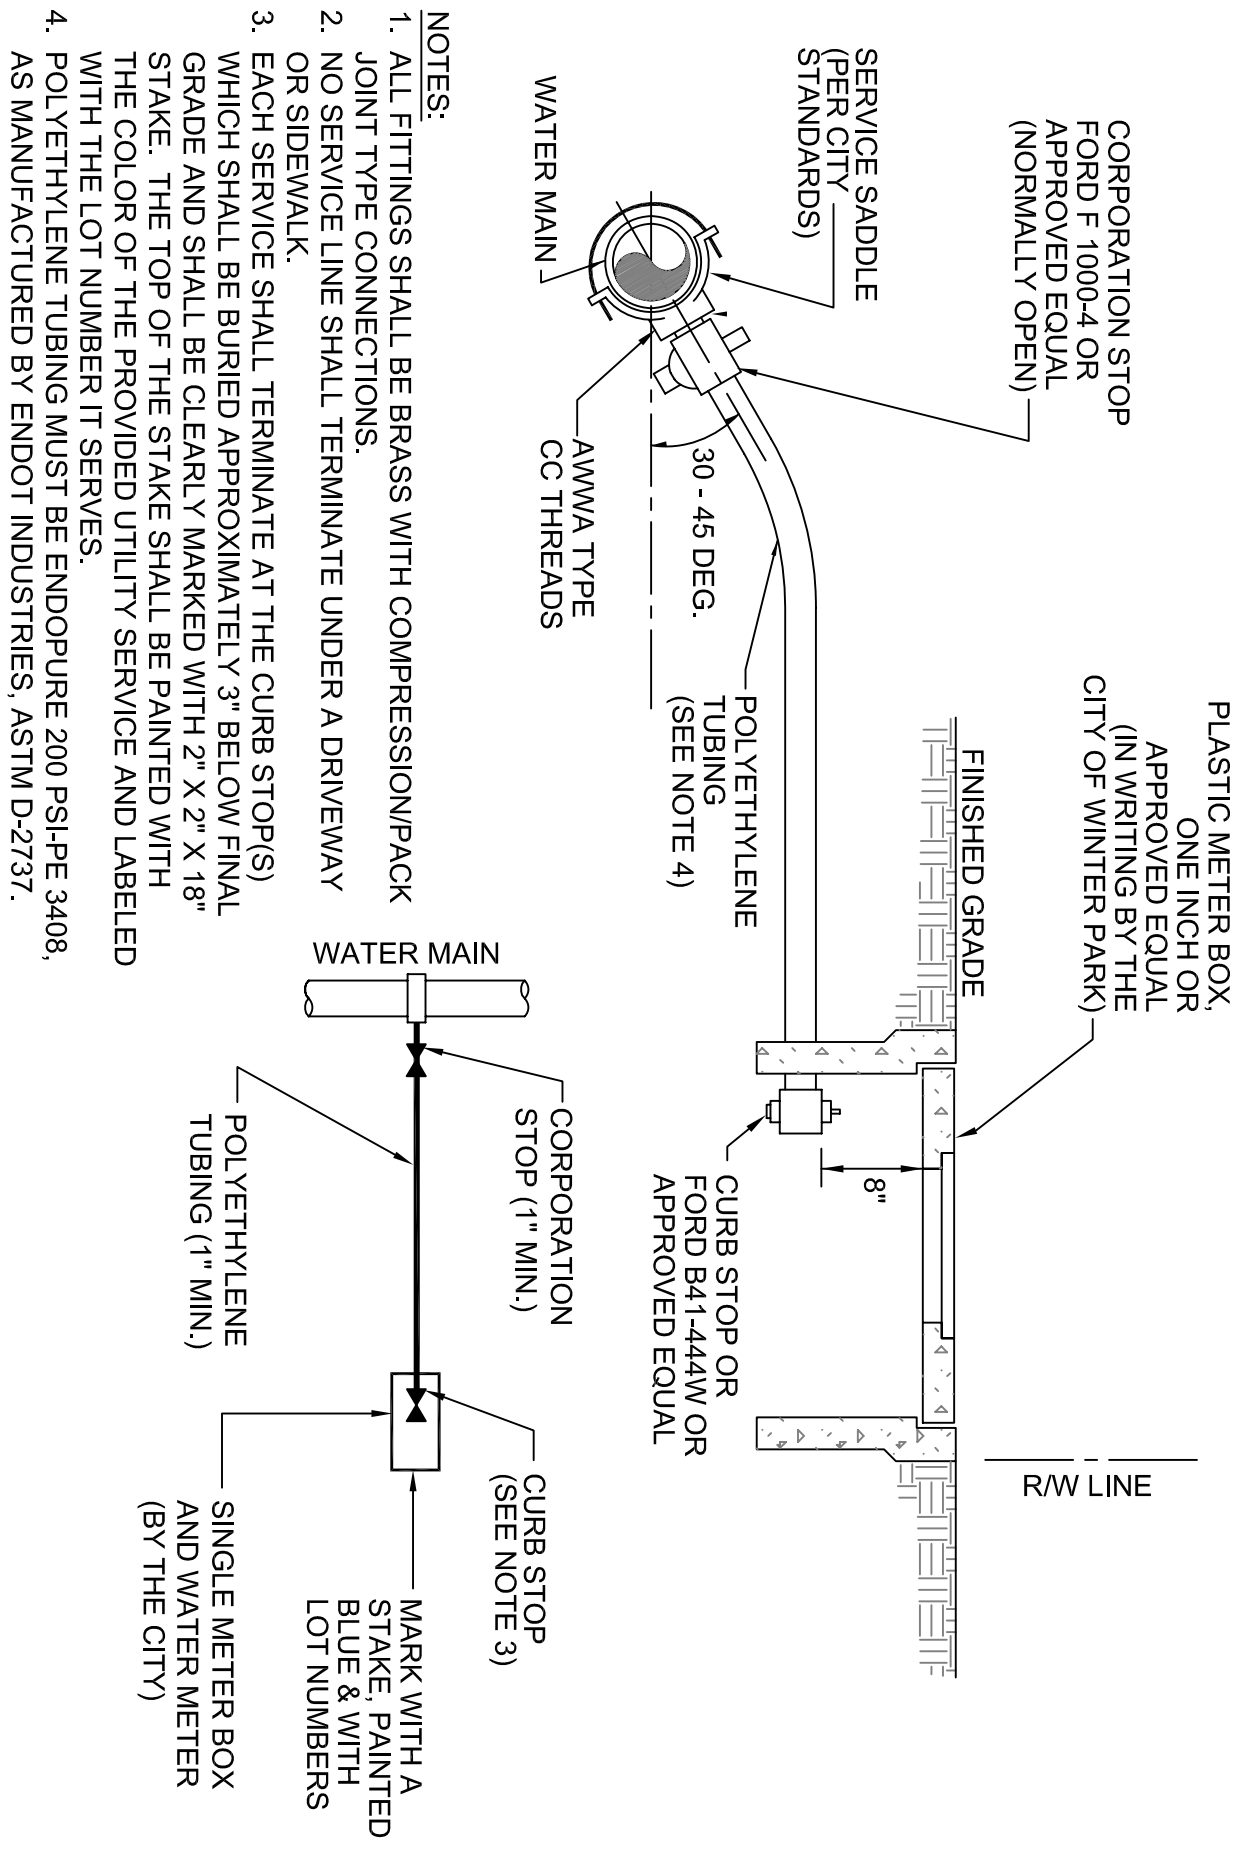

**NOTES:**

1. ALL FITTINGS SHALL BE BRASS WITH COMPRESSION/PACK JOINT TYPE CONNECTIONS.
2. NO SERVICE LINE SHALL TERMINATE UNDER A DRIVEWAY OR SIDEWALK.
3. EACH SERVICE SHALL TERMINATE AT THE CURB STOP(S) WHICH SHALL BE BURIED APPROXIMATELY 3" BELOW FINAL GRADE AND SHALL BE CLEARLY MARKED WITH 2" X 2" X 18" STAKE. THE TOP OF THE STAKE SHALL BE PAINTED WITH THE COLOR OF THE PROVIDED UTILITY SERVICE AND LABELED WITH THE LOT NUMBER IT SERVES.
4. POLYETHYLENE TUBING MUST BE ENDOPURE 200 PSI-PE 3408, AS MANUFACTURED BY ENDOT INDUSTRIES, ASTM D-2737.

FIGURE 31