

CITY OF WINTER PARK


WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

TEST BOX STATION

SCALE: N.T.S

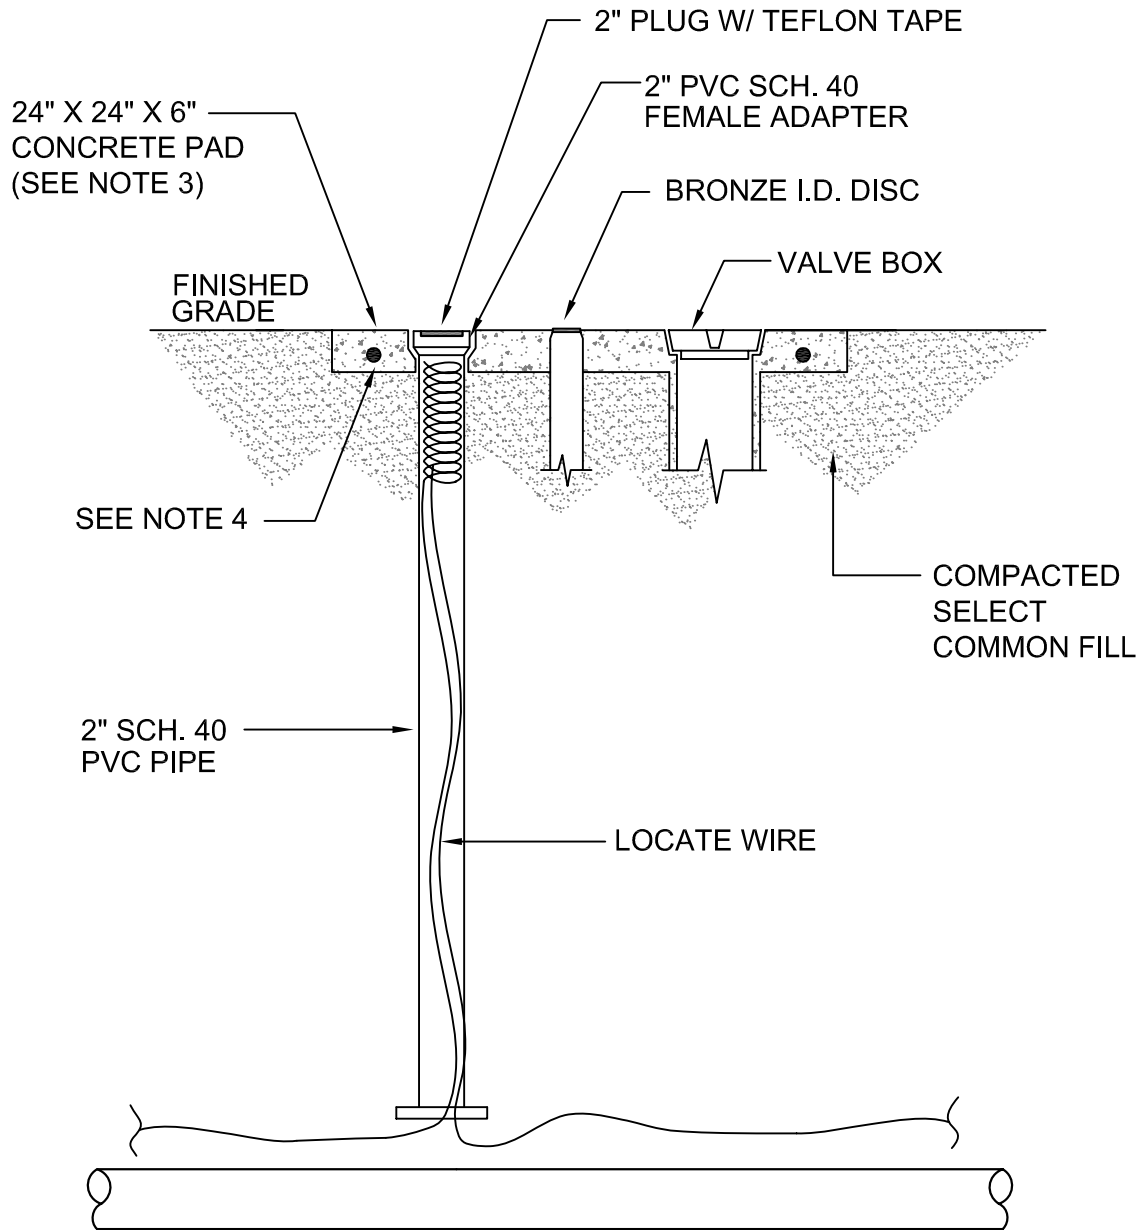

NOTES:

1. USED IN CONJUNCTION WITH MULTI PAD USAGE, DETAIL DOES NOT REPRESENT A STAND ALONE TEST BOX.
2. A STAND ALONE TEST BOX REQUIRES REVIEW AND APPROVAL BY THE CITY.
3. SEE FIGURE 10 FOR DETAILED CONCRETE PAD SPECIFICATIONS
4. THE LOCATING WIRE SHALL TERMINATE INSIDE THE TEST STATION BOX AND SHALL EXTEND 12" ABOVE TOP OF FINISHED GRADE.
5. #4 REBAR REQUIRED ALL AROUND.

FIGURE 42