

CITY OF WINTER PARK


WATER & WASTEWATER UTILITY DEPARTMENT

REFERENCE THE "WATER & WASTEWATER UTILITY STANDARDS, SPECIFICATIONS & DETAILS MANUAL"

DATE: January 2, 2008

GATE VALVE & BOX-WATER & RECLAIMED

SCALE: N.T.S

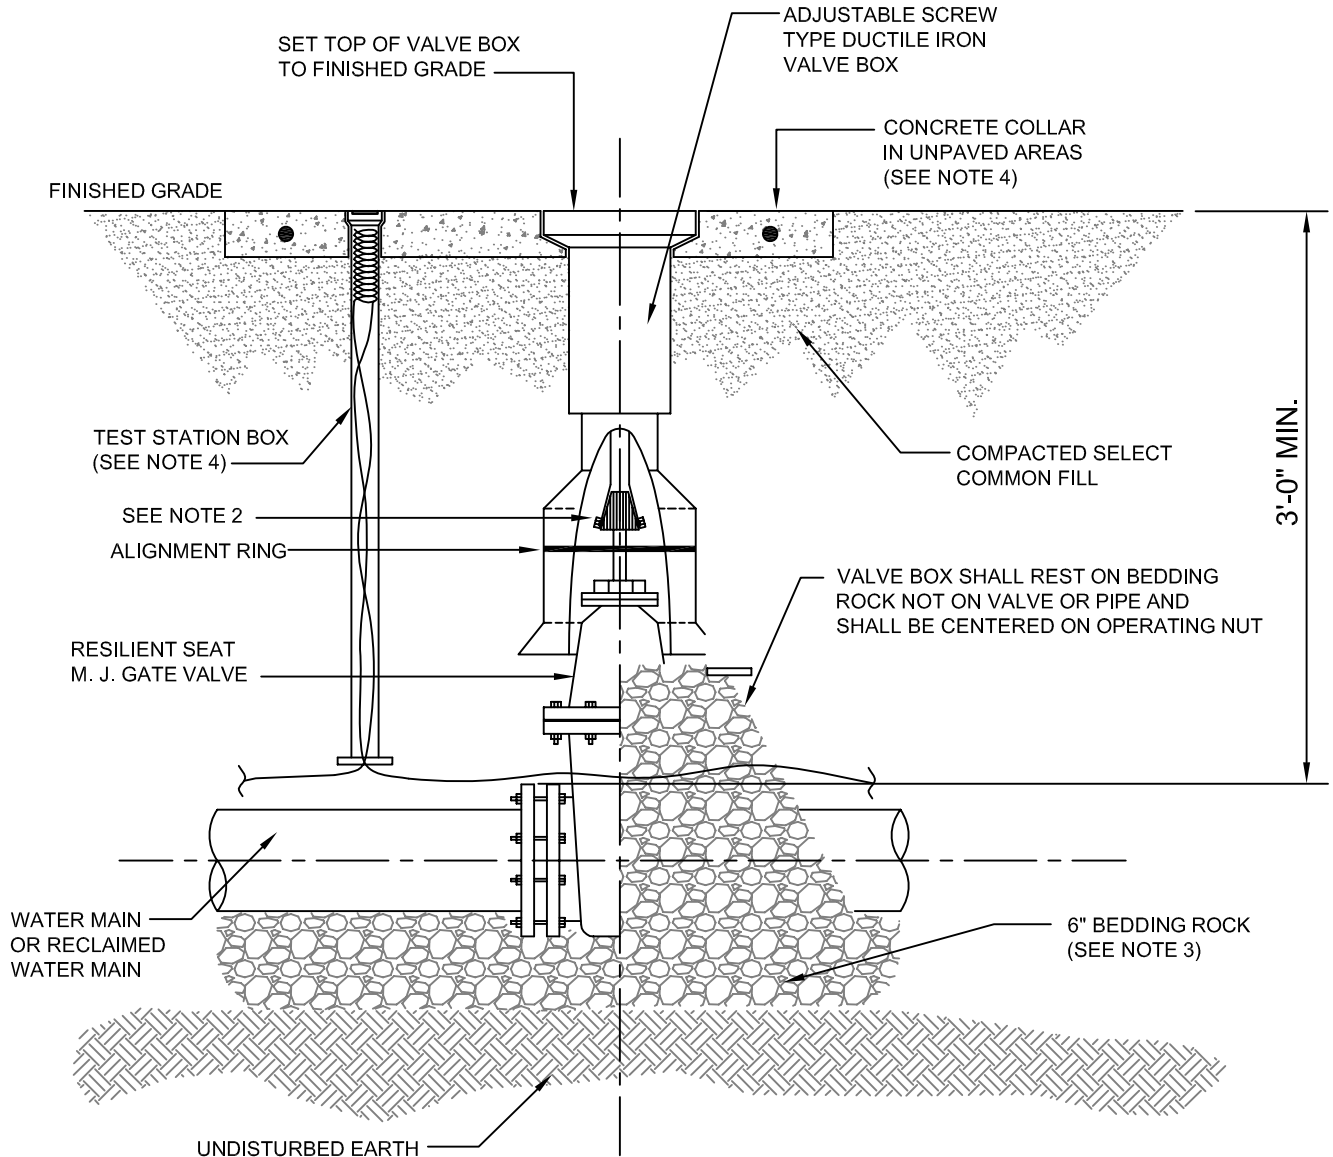

NOTES:

1. C900 PVC OR DUCTILE IRON PIPE SHALL BE USED ON VALVE BOX INSTALLATION.
2. THE VALVE ACTUATING NUT SHALL BE EXTENDED TO BE WITHIN 3' BELOW FINISHED GRADE.
3. BEDDING MATERIAL SHALL CONFORM TO FDOT NO. 57 AGGREGATE.
4. SEE FIGURE 10 AND 42 FOR DETAILED SPECIFICATIONS.
5. THE VALVE COVER BOX SHALL BE MARKED " WATER OR RECLAIMED".

FIGURE 6